

FEATURES

- Field-Bus remote data acquisition
- Modbus Slave device on RS-485
- Modbus RTU/ Modbus ASCII protocol
- 4 channel output
- Outputs configurable as Voltage or Current
- Watch-Dog Alarm
- Remotely Configurable
- 2000 Vac 3-ways Galvanic Isolation
- High Accuracy
- UL / CE mark
- DIN rail mounting in compliance with EN-50022



GENERAL DESCRIPTION

The DAT 3024 device generates 4 output analog signals from digital commands. The data are transmitted with MODBUS RTU/MODBUS ASCII protocol on the RS-485 network (RS-232 interface is available).

It is possible to generate voltage signals up to 10V and current signals up to 20mA, both active or passive loops.

The device guarantees high accuracy and stable measure versus time and temperature.

To ensure the plant safety, two Watch-Dog timer alarms are provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The DAT 3024 is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market.

The device is housed in a rough self-extinguishing plastic container which, thanks to its thin profile of 17.5mm only, allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The DAT3024 is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

If the module configuration is unknown, with device powered off, connect the INIT terminal to the GND terminal (ground), at the next power on the device will be auto-configured in the default settings (refer to the User Guide of the device).

Connect power supply, serial bus and analogue outputs as shown in the "Wiring" section.

The "PWR" LED state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

OUTPUT (4 channels)			Output Accuracy		POWER SUPPLY			
Output type	Min	Max	Current	Voltage	Power supply voltage	Reverse polarity protection		
Current mA	0 mA	+20 mA	± 20 uA	± 10 mV	18 .. 30 Vdc	60 Vdc max		
Voltage Volt	0 V	+10 V	Thermal drift		Current consumption	100 mA max.		
			Full scale	± 0.01 % / °C	ISOLATION			
			Load resistance		On all the ways	2000 Vac, 50 Hz, 1 min		
			Voltage	≥ 5 KΩ	ENVIRONMENTAL CONDITIONS			
			Current	≤ 500 Ω	Operative Temperature	-10°C .. +60°C		
			Auxiliary Voltage (4 channels)		UL Operative Temperature	-10°C .. +40°C		
			> 12V @ 20mA		Storage Temperature	-40°C.. +85°C		
			Response time		Humidity (not condensed)	0 .. 90 %		
			Slew-rate analogue output		Maximum Altitude	2000 m		
			(with dedicated setting for each channel)		Installation	Indoor		
			Value	V/s	mA/s	Category of installation	II	
			00h	Disabled		Pollution Degree	2	
			01h	0.15	0.30	MECHANICAL SPECIFICATIONS		
			02h	0.30	0.60	Material	Self-extinguish plastic	
			03h	0.60	1.20	IP Code	IP20	
			04h	1.20	2.40	Wiring	wires with diameter 0.8÷2.1 mm ² /AWG 14-18	
			05h	2.40	4.80	Tightening Torque	0.5 N m	
			06h	4.80	9.60	Mounting	in compliance with DIN rail standard EN-50022	
			07h	9.60	19.2	Weight	about 150 g.	
			08h	19.2	38.4	CERTIFICATIONS		
			09h	38.4	76.8	EMC (for industrial environments)		
			0Ah	76.8	153	Immunity	EN 61000-6-2	
			0Bh	153	306	Emission	EN 61000-6-4	
			0Ch	Immediate		UL		
			Data Transmission		Baud Rate	115.2 Kbps	US Standard	UL 61010-1
			Baud Rate		Max. distance	1.2 Km – 4000 ft	Canadian Standard	CSA C22.2 No 61010-1
			Max. distance				CCN	NRAQ/NRAQ7
							Typology	Open Type device
							Classification	Industrial Control Equipment
							File Number	E352854

INSTALLATION INSTRUCTIONS

The DAT 3024 is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and at least one of the overload conditions exist.
- If panel temperature exceeds 35°C and at least two of the overload conditions exist.

The overload conditions are the following:


- High supply voltage: >27Vdc
- Use of the auxiliary power supply

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.


CABLING

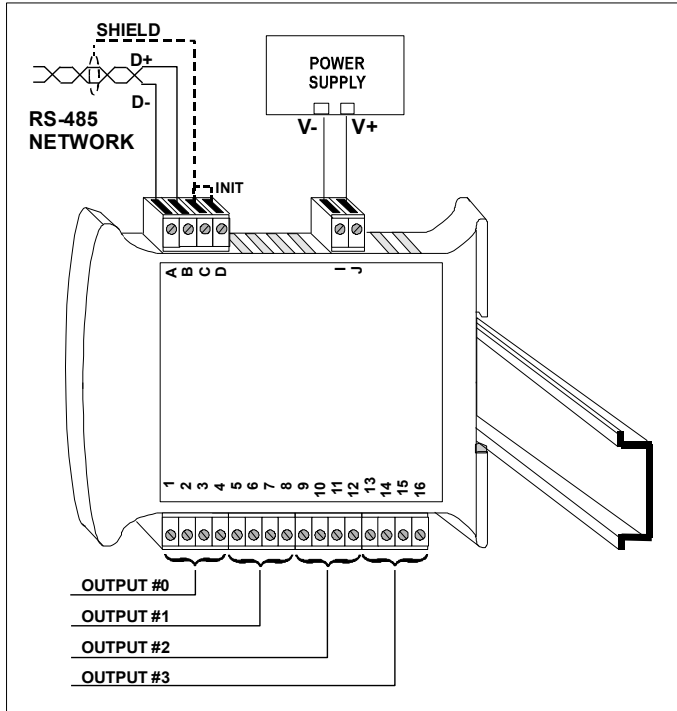

LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered / Wrong RS-485 cabling.
		FAST BLINK	Communication in progress (blink frequency depends to baud-rate)
		1 second BLINK	Watch-Dog Alarm condition


MECHANICAL DIMENSIONS (mm)

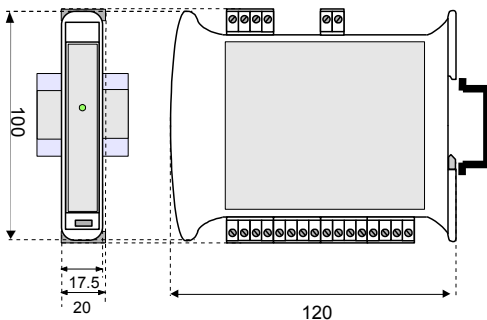

The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.

WIRING

ANALOGUE OUTPUTS

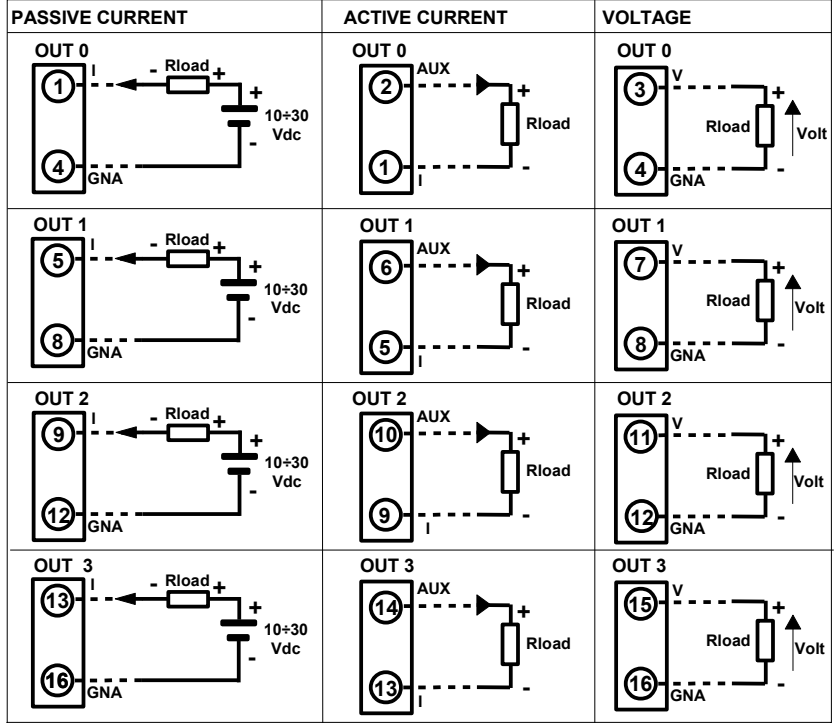


Note: the output channels are not isolated between them.


Terminals AUX of channels connected between them.

Terminals GNA of channels connected between them


RS-485 NETWORK

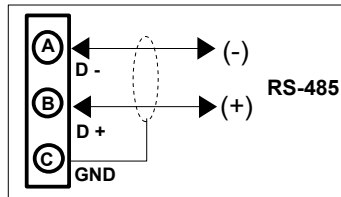


RS-232 NETWORK

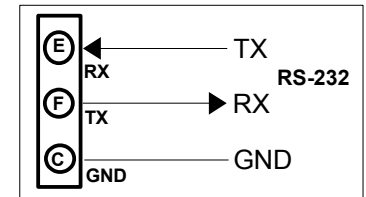

POWER SUPPLY (*)

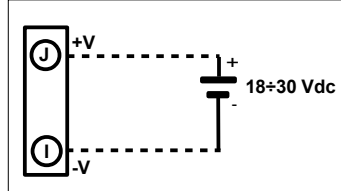

INIT (**)

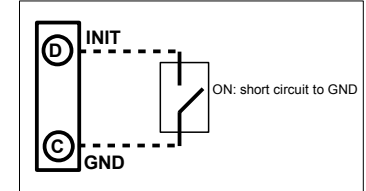

Notes:

(*) for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

(**) for RS232 version INIT and GND are inverted between them

ISOLATION STRUCTURE



HOW TO ORDER

In the order phase, it is mandatory to specify the interface type (RS485 or RS232). DAT3024 can be supplied with the configuration specified by the customer.

ORDER CODE:

DAT 3024 / 485 / mA

Interface type
485 : RS-485
232 : RS-232

Output type

■ = Requested
□ = Optional