



FEATURES

- Configurable input for RTD, TC, mV, Resistance and Potentiometer
- 1500 Vac 3-ways Galvanic Isolation
- Modbus Slave device over RS-485
- MODBUS RTU / MODBUS ASCII protocol
- High accuracy
- Remotely Configurable
- On-field reconfigurable
- EMC compliant – CE mark
- Suitable for DIN B in-head mounting
- Option for DIN rail mounting in compliance with EN 50022 (DIN RAIL Option)

GENERAL DESCRIPTION

The isolated converter DAT1485 is able to execute many functions such as measure and linearisation of the temperature characteristic of RTDs sensors, conversion of a linear resistance variation, conversion of an mV signal and conversion of a signal from a potentiometer connected to its input. The DAT1485 is able to measure and linearise the standard thermocouples with internal cold junction compensation. The measured values are converted into engineering units in digital format. The data are transmitted with MODBUS RTU / MODBUS ASCII protocol over the RS-485 network. The device guarantees high accuracy and performance stability both in time and in temperature. The programming of the DAT1485 is made by a Personal Computer using the software "MODBUS_3000_1000" developed and provided by DATEXEL.

The isolation between the parts of circuit removes the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

It is housed in a self-extinguish plastic enclosure suitable for DIN B in-head mounting.

Moreover, it is possible to mount the DAT1485 on DIN rail by proper mounting kit (**only on request**).

COMMUNICATION PROTOCOLS

The device is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT1485 device to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

It is possible to configure the device via software using the INIT modality. By setting the dip switch in INIT mode, the device will automatically be set in the set-up configuration when the device is turned on (refer to the User Guide of the device).

Connect power supply, serial bus and analogue inputs as shown in the "Wiring" section.

TECHNICAL SPECIFICATIONS (Typical at 25 °C and in nominal conditions)

Input type	Min	Max	Input calibration (1)	Sample time
TC (*) CJC int. J K S R B E T N	-200°C -200°C 0°C 0°C 400°C -200°C -200°C -200°C	1200°C 1300°C 1750°C 1750°C 1800°C 1000°C 400°C 1300°C	RTD > of ±0.1% f.s. or ±0.2°C	about 200 ms
			Low res. > of ±0.1% f.s. or ±0.15 Ω	
			High res. > of ±0.2% f.s. or ±1 Ω	
			mV, TC > of ±0.1% f.s. or ±10 uV	
			Input impedance	
			TC, mV ≥ 10 MΩ	
			Linearity (1)	
			TC, mV ± 0.2 % f.s.	
			RTD ± 0.1 % f.s.	
			Line resistance influence	
TC, mV ≤ 0.8 uV/Ohm	Power supply Power supply voltage 18 .. 30 Vdc Current consumption @24Vdc 14 mA typ. Current consumption @18Vdc 16 mA max Reverse polarity protection 60 Vdc max Isolation voltage Input - Pow. Supply 1500 Vac, 50 Hz, 1min Input - RS485 1500 Vac, 50 Hz, 1min Pow. Supply - RS485 1500 Vac, 50 Hz, 1min Temperature & humidity Operative temperature -40°C .. +85°C Storage temperature -40°C .. +85°C Humidity (not condensed) 0 .. 90 % Housing Material PC + ABS V0 Mounting DIN B head or bigger Weight about 50 g. Dimensions Ø = 43 mm; H = 24 mm			
RTD 3 wires 0.05%/Ω (50 Ω balanced max.)				
RTD excitation current				
Typical 0.400 mA				
CJC comp.				
± 1.5°C				
Thermal drift (1)				
Full scale ± 0.01% / °C				
CJC ± 0.01% / °C				
Warm-up time				
3 min				
Potentiometer (R nom. < 50 KΩ)	0 %	100 %	Data Transmission (RS-485 asynchronous serial)	
RES. 2,3 fili Res 500 Ω Res 2000 Ω	0 Ω 0 Ω	500 Ω 2000 Ω	Baud Rate 115.2 Kbps	
			Max. distance 1.2 Km – 4000 ft	
			Interface RS485 (2 wires) Protocol Modbus RTU / Modbus ASCII	
			EMC (for industrial environments)	
			Immunity EN 61000-6-2	
			Emission EN 61000-6-4	


(1) referred to input Span (difference between max. and min. values)

(*) For temperature sensors it is possible to set the input range also in °F or K degrees.


INSTALLATION INSTRUCTIONS

The device DAT1485 is suitable for direct DIN B in-head mounting. The converter must be fixed inside the probe by the proper kit. By apposite stirrup, provided on request, it is possible to mount the device on DIN rail in compliance with EN-50022. It is necessary to install the device in a place without vibrations and avoid to routing conductors near power signal cables. To avoid passive current loops, the shield of the communication cable (RS485) must only be connected at one point on the network.

DIN rail mounting (DIN RAIL Option)

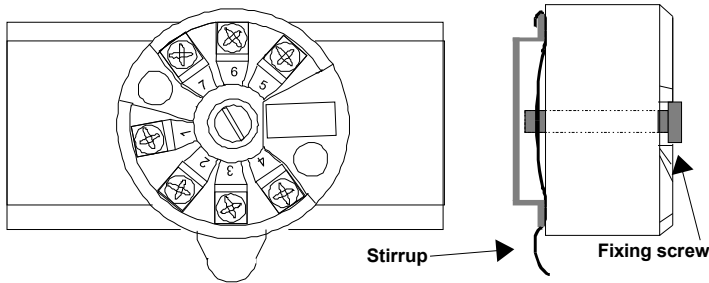


DIN B in-head mounting

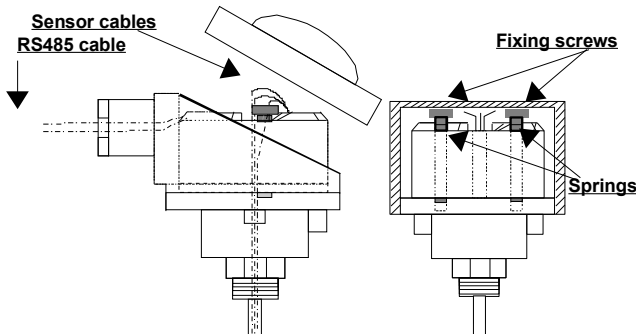

ISOLATIONS STRUCTURE




MECHANICAL DIMENSIONS (mm)

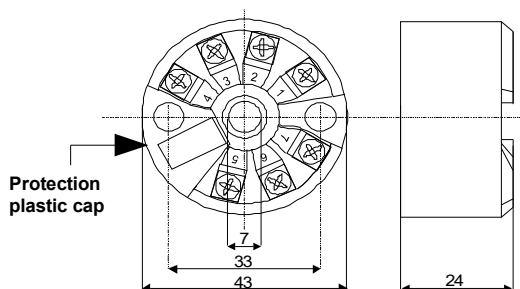


WIRING


INPUT CONNECTIONS

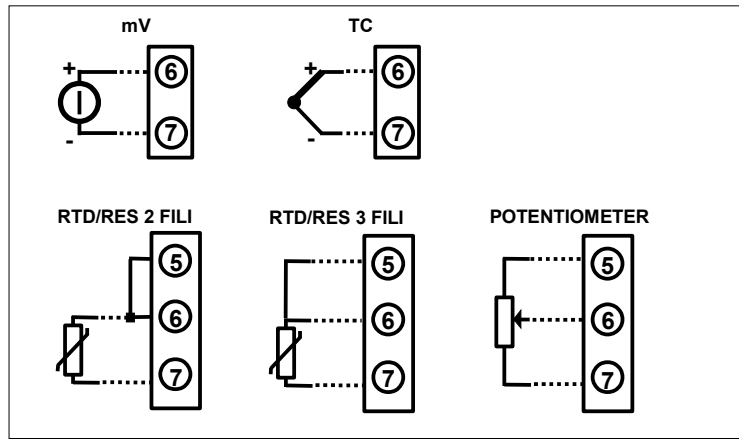

POWER SUPPLY CONNECTIONS

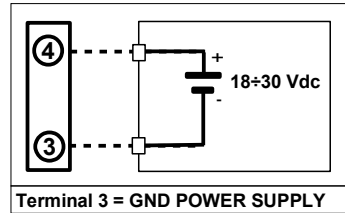


RS485 CONNECTIONS

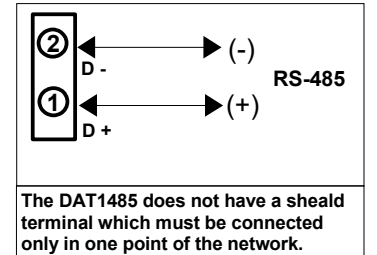

REGISTERS TABLE

Register	Description	Access
40001	Test	R/W
40002	Firmware [0]	RO
40003	Firmware [1]	RO
40004	Name [0]	R/W
40005	Name [1]	R/W
40006	Communication	R/W
40007	Address	R/W
40008	Delay RX/TX	R/W
40009	WatchDog timer	R/W
40010	System Flags	R/W
40011	Input type	R/W
40012	Degree Type	R/W
40013	Offset CJC	R/W
40014	Measure CJC	RO
40015	Input Value	RO
40023	Sync Input value	RO
40031	Input Offset	R/W



The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.

HOW TO ORDER

The DAT1485 is provided as requested on the Customer's order. The mounting kit for DIN rail is provided **only on request** with code DIN RAIL.

ORDER CODE EXAMPLE:

DAT1485 / Tc K

Input type