



## FEATURES

- Modbus Slave device on RS-485
- Modbus RTU/ Modbus ASCII protocol
- 4 input channels
- Input configurable for RTD, Resistance and Potentiometer
- Communication parameters configurable by dip-switches
- Watch-Dog Alarm
- Remotely Configurable
- 1500 Vac 3-ways Galvanic Isolation
- LEDs of signalling on front side for power supply and communication
- Connection by removable screw terminals
- High Accuracy
- CE mark
- DIN rail mounting in compliance with EN-50022

## GENERAL DESCRIPTION

The device DAT10014 converts up to 4 analogue input signals into engineering units in digital format. The data are transmitted with MODBUS RTU / MODBUS ASCII protocol over the RS-485 network.

It is possible to connect on input RTD, Potentiometer or Resistance sensors.

The device guarantees high accuracy and stable measure versus time and temperature.

To ensure the plant safety, a Watch-Dog timer alarm is provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The device is housed in a 6 module DIN rough self-extinguishing plastic box for mounting on EN-50022 standard DIN rail.

## COMMUNICATION PROTOCOLS

The device is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT10000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

## USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

It is possible to configure the device in two modes: by the dip-switches located on the front of the device or via software using the INIT modality.

Connect the terminal INIT to the terminal REF; at the power-on the device will be automatically set in the configuration set-up (refer to the User Guide of the device).

Connect power supply, serial bus and analogue inputs as shown in the "Wiring" section.

The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

## TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

INPUT			Input Accuracy (1)	POWER SUPPLY
Input type	Min	Max		
<b>RTD 2 or 3 wires</b>			RTD ±0.05 % f.s.	Power supply voltage 10 .. 30 Vdc
Pt100	-200 °C	850 °C	Resistance ±0.05 % f.s.	Reverse polarity protection 60 Vdc max
Pt1000	-200 °C	200 °C	Potentiometer ±0.05 % f.s.	<b>Current consumption</b>
Ni100	-60 °C	180 °C	<b>Linearity (1)</b>	(operative) 35 mA max@24Vdc
Ni1000	-60 °C	150 °C		RTD ± 0.1 % f.s.
<b>RES. 2 or 3 wires</b>			<b>Lead wire resistance influence</b>	<b>ISOLATION</b>
Low	0 Ω	500 Ω	RTD/res.3 wires(50 Ω max balanced) 0.05 f.s. % / Ω	Between all the ways 1500 Vac, 50 Hz, 1 min
High	0 Ω	2000 Ω	<b>RTD excitation current</b>	<b>ENVIRONMENTAL CONDITIONS</b>
<b>POT (Nominal Res)</b>			Typical 0.350 mA	Operative Temperature -10°C .. +60°C
Low	20 Ω	500 Ω	<b>Thermal drift (1)</b>	Storage Temperature -40°C.. +85°C
High	20 Ω	2000 Ω	Full scale ± 0.01 % / °C	Humidity (not condensed) 0 .. 90 %
			<b>Sample time</b> 0.5 ÷ 1 sec.	Maximum Altitude 2000 m
			<b>Data Transmission (RS-485 asynchronous serial)</b>	Installation Indoor
			Baud Rate 115.2 Kbps	Category of installation II
			Max. distance 1.2 Km – 4000 ft	Pollution Degree 2
			<b>Warm-up time</b> 3 min.	<b>MECHANICAL SPECIFICATIONS</b>
				Material Self-extinguish plastic
				IP Code IP20
				Wiring wires with diameter 0.8÷2.1 mm <sup>2</sup> /AWG 14-18
				Tightening Torque 0.5 N m
				Mounting in compliance with DIN rail standard EN-50022
				Weight about 200 g.
				<b>CERTIFICATIONS</b>
				<b>EMC ( for industrial environments)</b>
				Immunity EN 61000-6-2
				Emission EN 61000-6-4

(1) referred to the input Span (difference between max. and min.)

## INSTALLATION INSTRUCTIONS

The DAT10014 is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:


**When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:**

- If panel temperature exceeds 45°C and power supply voltage 10 Vdc.

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.

## WIRING

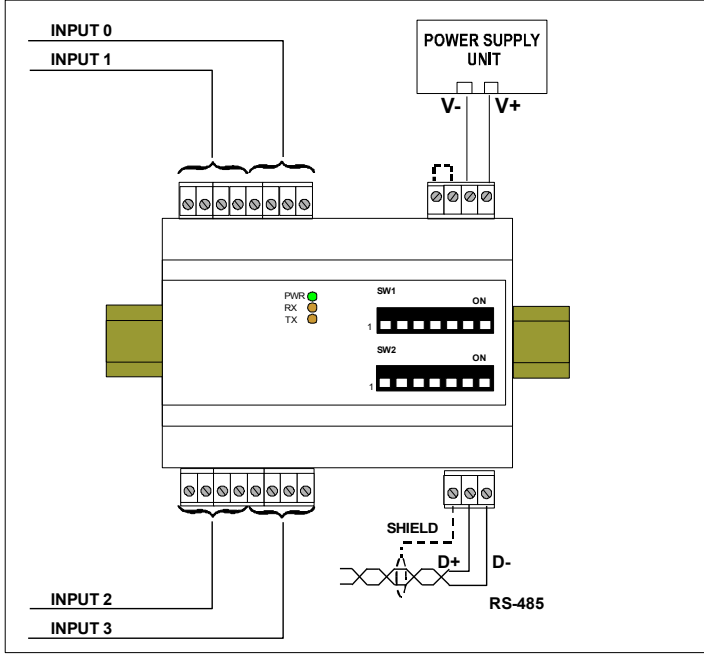


## LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	~1 sec. - Watch-Dog alarm condition occurred
RX	ORANGE	BLINK	Stream of data over receiving line of RS-485
		OFF	No data over receiving line of RS-485
TX	ORANGE	BLINK	Stream of data over transmission line of RS-485
		OFF	No data over transmission line of RS-485

## ISOLATION STRUCTURE






## MECHANICAL DIMENSIONS (mm)

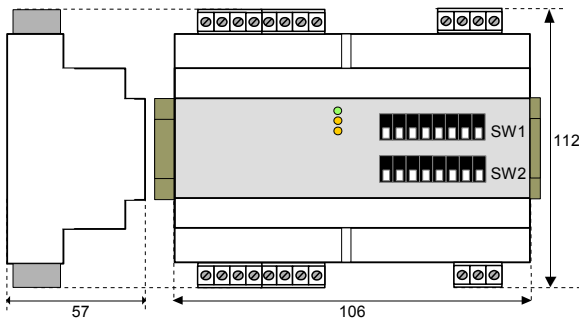


## CONNECTIONS

### ANALOGUE INPUTS

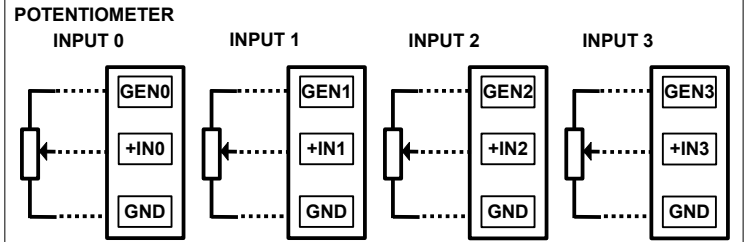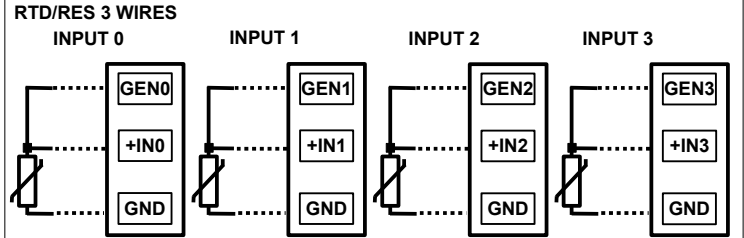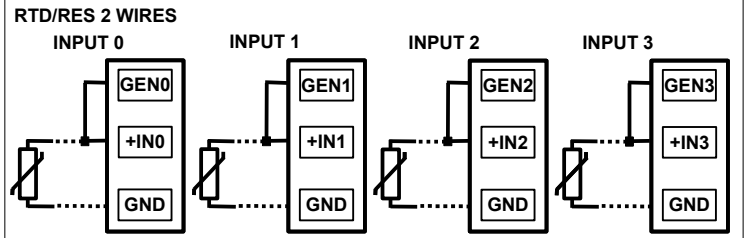


NOTE: the input channels are not isolated between them (terminal GND is common)


### SERIAL LINE RS-485

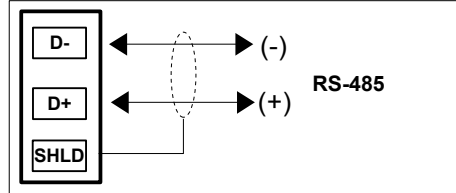

### POWER SUPPLY

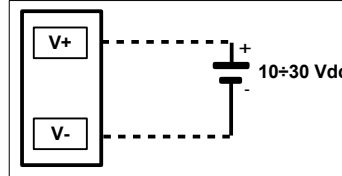


### INIT

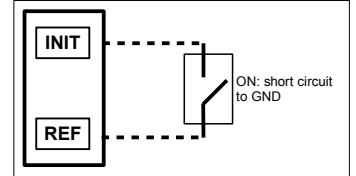


## DIP-SWITCHES : TABLES OF CONFIGURATION

Warning: set all the dip-switches in OFF position to access to the device in EEPROM modality (the device will follow all the communication parameters set by software) or INIT. Power-off the device before to change the set of the dip-switches.


TAB.1 Modality settings (Pos.1)



TAB.2 Parity settings (Pos.2 LSB; Pos.3 MSB)



TAB.3 Baud rate settings (Pos.4 LSB; Pos.6 MSB)

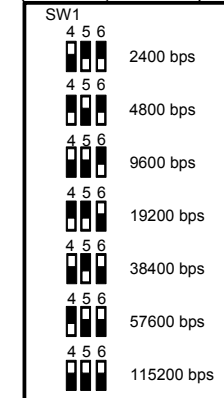

Note (\*):

- in Modbus RTU Modality the setting is NONE; number of bit = 8
- in Modbus ASCII Modality the setting is MARK; number of bit = 7

DIP POSITION

ON OFF

## HOW TO ORDER

The DAT10014 can be supplied as requested from the customer.

Refer to the section "Technical Specifications" for the input types available.

DAT 10014 / Pt100  Input type



The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste.

For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.

