



FEATURES

- Modbus Slave device on RS-485
- Modbus RTU/ Modbus ASCII protocol
- 8 relay outputs SPDT
- Communication parameters configurable by PC
- Watch-Dog Alarm
- Remotely Configurable
- 1500 Vac 3-ways Galvanic Isolation
- LEDs of signalling on front side for power supply and communication
- LEDs of signalling on front side for digital inputs and outputs state
- Connection by removable screw terminals
- High Accuracy
- CE mark
- DIN rail mounting in compliance with EN-50022



GENERAL DESCRIPTION

The device DAT3138 is able to drive up to 8 relay outputs SPDT. The data are transmitted with MODBUS RTU / MODBUS ASCII protocol over the RS-485 network.

To ensure the plant safety, a Watch-Dog timer alarm is provided.

The isolation between the parts of circuit removes eventual ground-loop effects, allowing the use of the device even in the heavy environmental conditions.

The device is housed in a rough self-extinguishing plastic container which allows a high density mounting on EN-50022 standard DIN rail.

COMMUNICATION PROTOCOLS

The device is designed to work with the MODBUS RTU/MODBUS ASCII protocol: standard protocol in field-bus; allows to directly interface DAT3000 series devices to the larger part of PLCs and SCADA applications available on the market.

For the protocol instructions, refer to the User Guide of the device.

USER INSTRUCTIONS

Before to install the device, please read the "Installation Instruction" section.

It is possible to configure the device via software using the INIT modality.

Connect the terminal INIT to the terminal -V; at the power-on the device will be automatically set in the configuration set-up (refer to the User Guide of the device).

Connect power supply, serial bus and digital outputs as shown in the "Wiring" section.

The LEDs state depends on the working condition of the device: see the "Light Signalling" section to verify the device working state.

To perform configuration and calibration operations, read the instructions in the User Guide of the device.

To simplify handling or replacing of the device, it is possible to remove the wired terminals even with the device powered.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and under nominal conditions)

DIGITAL OUTPUT Channel 8 Type N° 8 relays SPDT Maximum Switching Power Resistive load - per contact 2 A @ 250 Vca 2 A @ 30 Vdc Max. voltage 250Vca (50 / 60 Hz) 30Vdc Dielectric strength between contacts 1000 Vca, 50 Hz, 1 min. Dielectric strength between coil and contacts 4000 Vca, 50 Hz, 1 min.	POWER SUPPLY Power supply voltage 20 .. 30 Vdc Reverse polarity protection 60 Vdc max Current consumption (stand-by) 20 mA @ 24 Vdc Current consumption (relays operative) 100 mA max@24Vdc 90 mA max@20Vdc
	ISOLATION Between all the ways (RS485, power supply, digital outputs) 1500 Vac, 50 Hz, 1 min
	ENVIRONMENTAL CONDITIONS Operative Temperature -10°C .. +60°C Storage Temperature -40°C.. +85°C Humidity (not condensed) 0 .. 90 % Maximum Altitude 2000 m Installation Indoor Category of installation II Pollution Degree 2
	MECHANICAL SPECIFICATIONS Material Self-extinguish plastic IP Code IP20 Wiring wires with diameter 0.8÷2.1 mm ² /AWG 14-18 Tightening Torque 0.5 N m Mounting in compliance with DIN rail standard EN-50022 Weight about 210 g
COMMUNICATION Data Transmission (RS-485 asynchronous serial) Baud Rate up to 115.2 Kbps Max. distance 1.2 Km – 4000 ft Protocol Modbus RTU/Modbus ASCII Serial Interface RS485 (2 wires)	CERTIFICATIONS EMC (for industrial environments) Immunity EN 61000-6-2 Emission EN 61000-6-4

INSTALLATION INSTRUCTIONS

The DAT3138 is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:


When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and power supply voltage 10 Vdc. Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.

CABLING

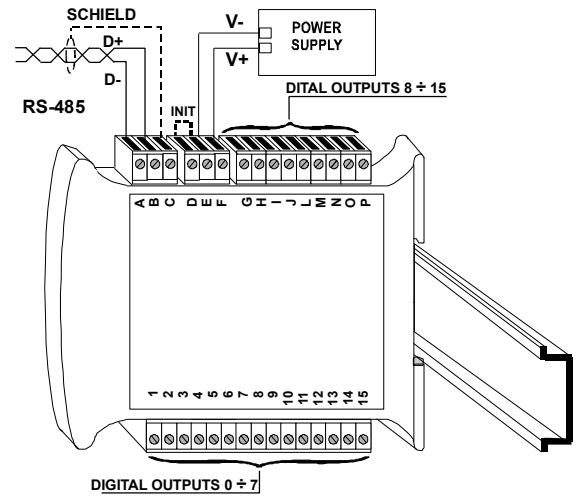


WIRING

RELAYS WIRING

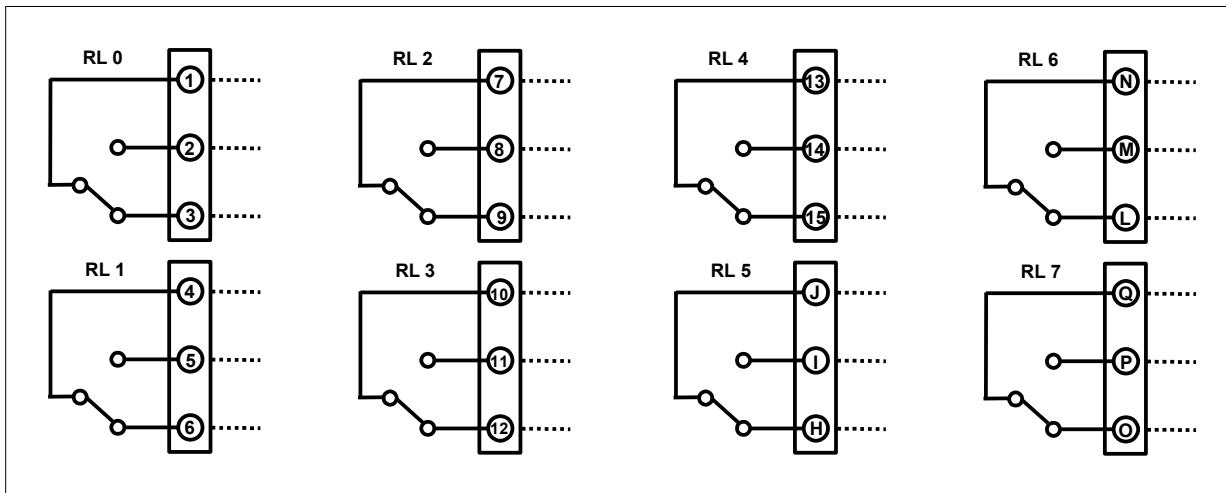


POWER SUPPLY (*)

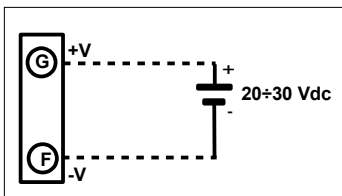


(*) Note: the device must be powered using a power supply unit classified NEC class 2 or SELV


INIT

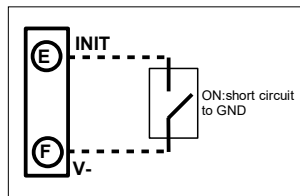

RS-485 SERIAL PORT

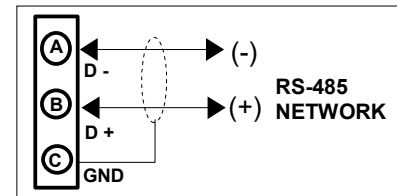

MECHANICAL DIMENSIONS (mm)

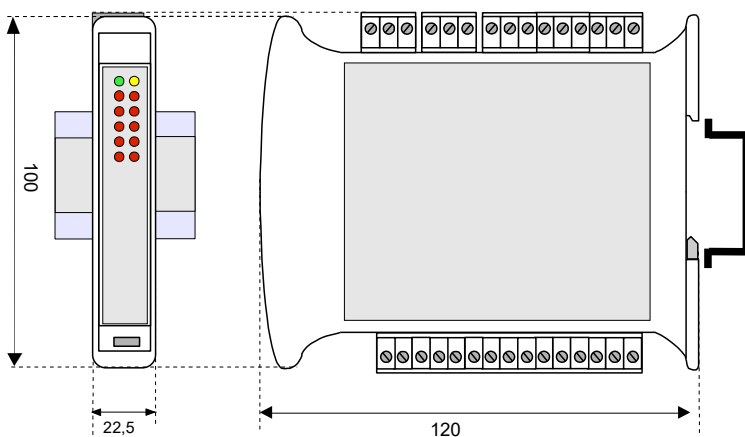

LIGHT SIGNALLING

LED	COLOR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINK	~1 sec. - Watch-Dog alarm condition occurred
STS	YELLOW	BLINK	~1 sec. - INIT condition
		ON	Short-Circuit alarm condition occurred
RX	RED	BLINK	Stream of data over receiving line of RS-485
		OFF	No data over receiving line of RS-485
TX	RED	BLINK	Stream of data over transmission line of RS-485
		OFF	No data over transmission line of RS-485
DO _n	RED	ON	Digital output ON state
		OFF	Digital output OFF state

ISOLATION STRUCTURE



HOW TO ORDER
DAT 3138

The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.