



•FEATURES

- N.1 serial interface RS-485 Modbus RTU Master
- N.1 serial interface RS-485/232 Modbus RTU Slave
- Interface Ethernet 10/100Base-T, Modbus TCP Server
- N.4 Digital Inputs
- N.2 SPDT Relay Outputs
- Functional Block programming software
- Remotely programmable
- Connection by removable screw-terminals
- LED signalling for Link/Act Ethernet, serial RX-TX, power supply
- LED signalling for digital inputs and digital outputs state
- Galvanic Isolation on all the ways
- EMC compliance – CE mark
- Suitable for DIN rail mounting in compliance with EN-50022 standard



GENERAL DESCRIPTION

The device DAT9000IO is an Intelligent unit able to control a network of slave Modbus RTU devices connected on serial line RS-485 Master executing the reading and writing of the field values and performing the logical and mathematical functions necessary for the system working.

Moreover, the device is equipped with 4 digital inputs channels and 2 relay outputs. On digital inputs are available 32-bit counters and up to 300Hz frequency measures. By means of the Ethernet interface or the RS-485 "SLAVE" or RS-232 ports it is possible to read and write, in real time, the internal registers value.

Moreover, by means of the Ethernet interface, or by the RS-485 "SLAVE" or RS-232 ports it is possible to:

- Programming of the Control Logic
- Monitor, request of data, programming in real time the Intelligent Unit.
- Direct programming and request of data from the Slave devices connected on the RS-485 Master.

The device DAT9000IO is configurable by the software *DEV9K* developed by DATEXEL and running under Windows.

The device DAT9000IO realizes a full electrical isolation between the lines, introducing a valid protection against the effects of all ground loops eventually existing in industrial applications.

LED signalling of Ethernet activity and data rx-tx flow on the serial line allows a direct monitoring of the system functionality. The connection is made by removable screw-terminals (supply and RS-485) and RJ45 plug (Ethernet and RS-232).

The device is housed in a rough self-extinguishing plastic enclosure which, thanks to its thin profile of 22.5 mm only, allows a high density mounting on EN-50022 standard DIN rail.

LIST OF SUPPORTED FUNCTION

- Communication:
- Read data from "slave" devices (Modbus function 04)
 - Write data to "slave" devices (Modbus function 16)
- Logical:
- Boolean(And, Or,)
 - Compare (>, <, =,
 - Arithmetical (Sum, Subtraction, Multiplication, Division
 - Calculation (Scaling, Exponential functions, Square root extraction, Arithmetic mean,
- Process:
- Conditional statements (IF)
 - Flow control (Goto, Call,

For the complete list of functions and their operation, refer to the Programming software User Guide.

TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in the nominal conditions)

| | | | | | |
|---|--|--|--------------|--|---|
| In compliance with Ethernet IEEE 802.3 EIA RS485 and RS232 | | Digital Inputs | | Power supply | |
| | | Channels | 4 | Current consumption | 18 ÷ 30 Vdc 45 mA typ. @ 24Vdc(standby) 100 mA max |
| Network interface Protocol | Ethernet 10/100Base-T Modbus TCP Server | Input voltage | (bipolar) | Isolations | |
| RS485 Interface Baud-rate | up to 115.2 Kbps | OFF state | 0 ÷ 3 V | Power supply / Ethernet | 1500 Vac, 50 Hz, 1 min. |
| Max. distance (recommended) (1) | 1.2 Km @ 38.4 Kbps | ON state | 10 ÷ 30 V | Power supply / RS485 | 1500 Vac, 50 Hz, 1 min. |
| Number of modules in multipoint | up to 32 | Impedance | 4.7 KΩ | Ethernet / RS485 | 1500 Vac, 50 Hz, 1 min. |
| Internal termination resistance (optional) | 120 Ohm | Freq | up to 300 Hz | Inputs / RS485 | 2000 Vac, 50 Hz, 1 min. |
| | | Digital Outputs | | Inputs / Power supply | 2000 Vac, 50 Hz, 1 min. |
| | | Channels | 2 | Connections | |
| | | Type | SPDT Relays | Ethernet | RJ-45 (on terminals side) |
| | | Switching Power (max.) | | RS-232D | RJ-45 (on front side) |
| | | 2 A @ 250 Vac (resistive load) per contact | | RS-485 / Supply | Removable screw terminals |
| | | 2 A @ 30 Vdc (resistive load) per contact | | Environmental Conditions | |
| | | Minimum load 5Vdc , 10mA | | Operative temperature | -20 ÷ +60 °C |
| | | Max. voltage 250Vac (50 / 60 Hz) , 30Vdc | | Storage temperature | -40 ÷ +85 °C |
| | | | | Relative humidity (not cond.) | 0 ÷ 90 % |
| | | | | Maximum Altitude | 2000 m |
| | | | | Installation | Indoor |
| | | | | Category of installation | II |
| | | | | Pollution Degree | 2 |
| | | | | Mechanical Specifications | |
| | | | | Material | Self-extinguish plastic |
| | | | | IP Code | IP20 |
| | | | | Wiring | wires with diameter 0.8+2.1 mm ² /AWG 14-18 |
| | | | | Tightening Torque | 0.8 N m |
| | | | | Mounting | in compliance with DIN rail standard EN-50022 |
| | | | | Dimensions in mm.(WxHxT) | 100 x 120 x 22.5 |
| | | | | Weight | about 160 gr. |
| | | | | EMC (for industrial environments) | |
| | | | | Immunity | EN 61000-6-2 |
| | | | | Emission | EN 61000-6-4 |

(1) – The maximum distance depends of: number of devices connected, type of cabling, noises, etc...

INSTALLATION INSTRUCTIONS

The Intelligent Unit DAT9000IO is suitable for fitting to DIN rails in the vertical position.

For optimum operation and long life follow these instructions:

When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:

- If panel temperature exceeds 45°C and high power supply value(> 27Vdc).


Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.

Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.

MODBUS REGISTERS MAPPING

| Register | Description | Access |
|-----------|---------------------------|--------|
| %R0 | --Reserved-- | R/W |
| %R1 | Firmware [0] | R |
| %R2 | Firmware [1] | R |
| %R3 | Name [0] | R/W |
| %R4 | Name [1] | R/W |
| %R5 | Port 1 [BaudRate] | R/W |
| %R6 | Node ID | R/W |
| %R7 | Port 1 [Timeout RX] | R/W |
| %R8 | Digital Inputs | R/W |
| %R9 | Digital Outputs | R/W |
| %R10 | System Flags | R/W |
| %R11 | --Reserved-- | - |
| %R12 | --Reserved-- | - |
| %R13 | PC | R |
| %R14 | Status [0] | R |
| %R15 | Status [1] | R |
| %R16 | COM Errors | R/W |
| %R17 | Gateway Mask [L-H] | R/W |
| %R18 | Port 0 [Settings] | R/W |
| %R19 | Port 0 [Settings] | R/W |
| %R20 | Timers Enable | R/W |
| %R21 | --Reserved-- | - |
| %R22 | --Reserved-- | - |
| %R23 | --Reserved-- | - |
| %R24 | --Reserved-- | - |
| %R25 | --Reserved-- | - |
| %R26 | General Purpose Registers | R/W |
| %R927 | Freq [0] | R |
| %R928 | Freq [1] | R |
| %R929 | Freq [2] | R |
| %R930 | Freq [3] | R |
| %R931 | Counter [0] | R/W |
| %R932-933 | Counter [1] | R/W |
| %R934-935 | Counter [2] | R/W |
| %R936-937 | Counter [3] | R/W |
| %R938-939 | Memory Registers | R/W |
| %R1024 | | |
| %R1279 | | |


MECHANICAL DIMENSIONS (mm)

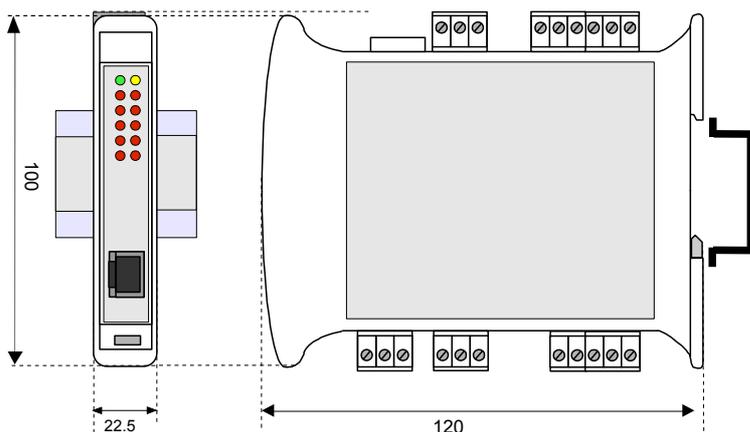


WIRING

SERIAL PORTS


RS-485 Slave (Port 0)

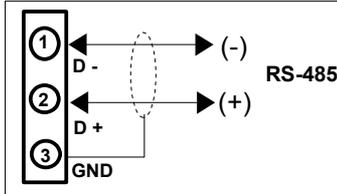


RS-485 Master (Port 1)

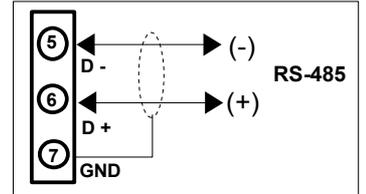


RS-232D Slave (Port 0)

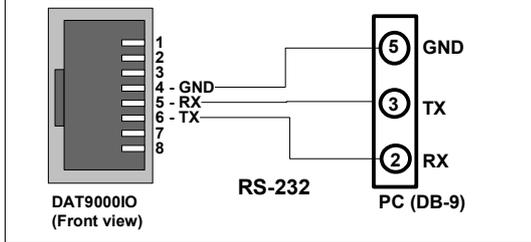


POWER SUPPLY

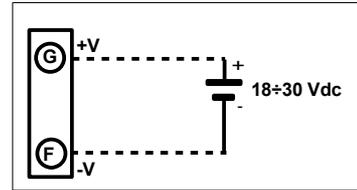


INIT

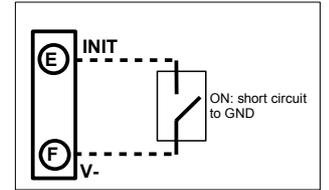

DIGITAL INPUTS

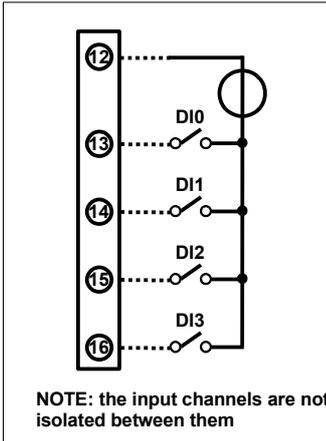

RELAY OUTPUTS

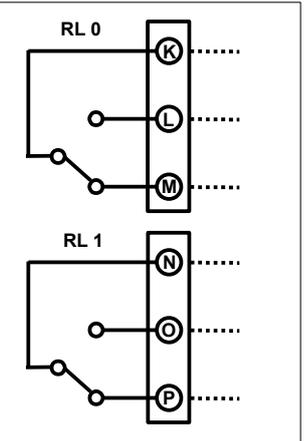

LIGHT SIGNALLING

| LED | COLOR | STATE | DESCRIPTION |
|-------------|--------|-------|--|
| PWR | GREEN | ON | Device powered |
| | | OFF | Device not powered / Wrong RS-485 connection |
| STS | YELLOW | BLINK | DEBUG modality |
| | | OFF | RUN modality |
| RX <i>n</i> | RED | BLINK | PORT <i>n</i> - Data received (the blink frequency depends on Baud-rate) |
| | | OFF | No reception in progress. |
| TX <i>n</i> | RED | BLINK | PORT <i>n</i> - Data transmitted (the blink frequency depends on Baud-rate) |
| | | OFF | No reception in progress. |
| I <i>n</i> | RED | ON | State 1 Digital Inputs. |
| | | OFF | State 0 Digital Inputs. |
| O <i>n</i> | RED | ON | State 1 Digital Outputs. |
| | | OFF | State 0 Digital Outputs. |

HOW TO ORDER

“ DAT 9000IO “

■ = Requested
□ = Optional