

Isolated DC current converter 0-40 Amps, 0-50Amps, and 0-60Amps.

## DAT 5023Idc-C

### FEATURES

- Input for DC current signal
- Build-in pluggable cross connector
- Measure by Hall effect transducer
- Isolated power supply source for passive loads on output
- Voltage or current output configurable by DIP-switches
- Galvanic isolation at 2000 Vac
- Good accuracy and performance stability
- EMC compliant – CE / UKCA mark
- DIN rail mounting in according to EN-50022 and EN-50035 standards



### GENERAL DESCRIPTION

The converter DAT 5023Idc is designed to convert the DC current signal from 0÷5 A to 0÷60 A applied on its input in a voltage or current output signal. The device is available in three versions (A, B and D) in function of the input current value ( refer to "Technical specification" section).

The user can program the output ranges by the proper DIP-switches available after opening the suitable door located on the side of device (see "Output ranges table" sections). The regulation of Zero and Span values is made by the ZERO and SPAN potentiometers located on the top of device.

The 2000 Vac isolation between power supply and output eliminates the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

The measure of the input signal is executed by a cross connector and a Hall effect transducer; this allows to isolate the input side from the output and power supply. The DAT 5023Idc provides on the output side an auxiliary supply source to connect both active and passive loads.

It is housed in a plastic enclosure of 27.5 mm thickness suitable for DIN rail mounting in according to EN-50022 and EN-50035 standards .

### OPERATIVE INSTRUCTIONS

The connections must be made as shown in the section "Wiring".

The configuration of the output ranges values is made by DIP-switches (refer to the section "Output ranges table").

After the converter configuration, it is necessary to calibrate it using the ZERO and SPAN regulations; this operation is illustrated in the section "Configuration and calibration". To install the device refer to the section "Installation instructions".

### TECHNICAL SPECIFICATIONS (Typical @ 25 °C and in nominal conditions)

INPUT		OUTPUT			GENERAL SPECIFICATIONS	
Device version	Signal Type (fixed)	Signal Type (configurable)	Min	Max		
DAT5023Idc/A	0÷5 A 0÷10 A	Voltage	0 V	10 V	Power supply voltage	18 .. 30 Vdc
DAT5023Idc/B	0÷20 A 0÷25 A		2 V	10 V	Reverse polarity protection	60 Vdc max
DAT5023Idc/D	0÷30 A	Current	0 V	5 V	Current consumption max.	Current: 90 mA Voltage: 60 mA
	0÷40 A 0÷50 A 0÷60 A		1 V	5 V	<b>ISOLATION</b> Among all the ways 1500 Vac, 50 Hz, 1 min	
Type of measure	Direct	<b>Output Adjustment</b> Zero ± 40 % of f.s. maximum Span ± 40 % of f.s. maximum			<b>ENVIRONMENTAL CONDITIONS</b> Operative temperature -20°C .. +60°C Storage temperature -40°C .. +85°C Humidity (not condensing) 0 .. 90 % Maximum Altitude 2000 m slm Installation Indoor Category of Installation II Pollution Degree 2	
Cross connector	Diameter: 8 mm	<b>Load resistance - Rload</b> Current: ≤ 500 Ω Voltage: ≥ 5 KΩ			<b>MECHANICAL SPECIFICATIONS</b> Material Self-extinguish plastic IP Code IP20 Wiring wires with diameter 0.8÷2.1 mm <sup>2</sup> AWG 14-18 Tightening Torque 0.8 N m Mounting in compliance with DIN rail standard EN-50022 and EN-50035 Weight about 170 g.	
		<b>Auxiliary power supply(Aux. Supply out )</b> 12 Vdc min @ 20 mA			<b>CERTIFICATIONS</b> <b>EMC ( for the Industrial Environments )</b> Immunity EN 61000-6-2 Emission EN 61000-6-4 <b>UKCA (ref S.I. 2016 N°1091 )</b> Immunity BS EN 61000-6-2 Emission BS EN 61000-6-4	
		<b>Accuracy</b> ± 0.1 % del f.s.				
		<b>Linearity Error (*)</b> ± 1 % del f.s.				
		<b>Thermal Drift</b> ± 0.02 % del f.s./°C				
		<b>Response Time(10÷ 90%)</b> 400 ms				

(\*)inclusive of hysteresis and variations of power supply voltage

## CONFIGURATION & CALIBRATION

- 1) Refer to the " Output ranges table " and determine in the column " Output " the position of the output value.  
In the correspondent lines is shown how to set the DIP-switches .
- 2) Set the DIP-switches as indicated .
- 3) Connect the input cable in the cross connector.
- 4) Set the minimum value of the input range.
- 5) By the ZERO potentiometer calibrate the output at the minimum value .
- 6) Set the maximum value of the input range.
- 7) By the SPAN potentiometer calibrate the output at the maximum value .
- 8) Repeat the operation from the step 4 to the step 7 until the output value will be correct ( 3 attempts typically required).

**Configuration ex.(DAT 5023ldc/A) :** out 0÷10 Vdc


Output switches configuration (SW2):Off, Off, Off, Off.

## OUTPUT RANGE TABLE

OUTPUT	SW2			
	1	2	3	4
0 ÷ 20 mA				●
4 ÷ 20 mA	●	●		●
1 ÷ 5 V	●	●	●	
0 ÷ 5 V			●	
2 ÷ 10 V	●	●		
0 ÷ 10 V				

● = DIP SWITCHES " ON"

## ISOLATION STRUCTURE

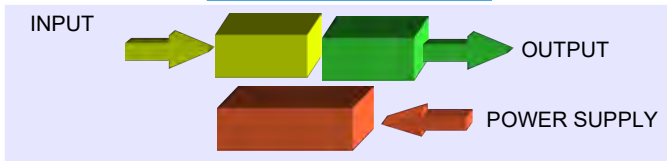

## INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in the vertical position.

For optimum operation and long life follow these instructions:

**When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following case:**

- If panel temperature exceeds 45°C and **at least one** of the overload conditions exists.
- If panel temperature exceeds 35°C and **at least two** of the the overload conditions exist.

### Overload conditions:


- High power supply values (> 27 Vdc).
- Use of current output (terminal P).
- Use of output auxiliary supply (terminal O).

Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel. Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters, etc...) and to use shielded cable for connecting signals.

## WIRING


### INPUT CONNECTION

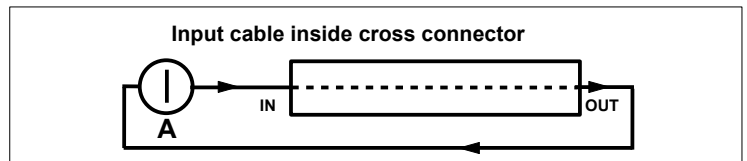

### POWER SUPPLY CONNECTIONS

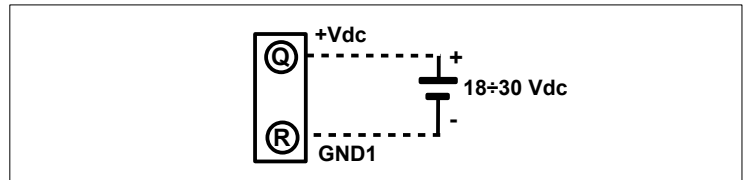


### OUTPUT CONNECTIONS

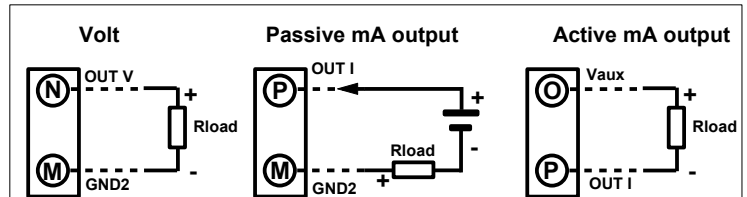

Note: terminals I = L = G = H = E = F not connected (N.C.)


## DIMENSIONS (mm) & REGULATIONS

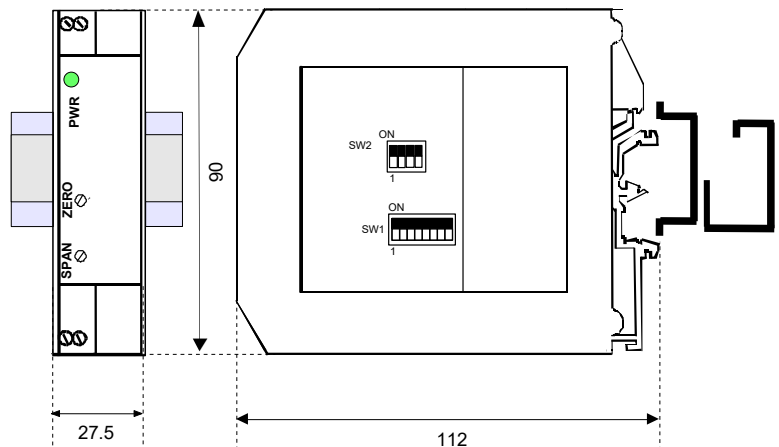

## HOW TO ORDER

The DAT 5023ldc is supplied as requested on the order.

**ORDER CODE EXAMPLE:** DAT 5023lac/A 0÷5 A - 0÷10 V



The symbol reported on the product indicates that the product itself must not be considered as a domestic waste. It must be brought to the authorized recycle plant for the recycling of electrical and electronic waste. For more information contact the proper office in the user's city, the service for the waste treatment or the supplier from which the product has been purchased.