



Dual Channel Thermistor Converter

FEATURES

- Configurable input for PTC and Potentiometer
- Configurable input for NTC Coster 1K and Coster 10K
- Configurable output in current or voltage
- Double channel in the same enclosure
- Configurable by dip-switch or PC
- High accuracy
- On-field reconfigurable
- Galvanic isolation among the ways
- UL / CE / UKCA mark
- Suitable for DIN rail mounting in compliance with EN-50022 and EN-50035



GENERAL DESCRIPTION

The isolated converter DAT 4532 C is able to measure and linearise the PTC type KTY81 and KTY84, NTC sensors exclusively type Coster 1K and 10K and potentiometers. In function of programming, the measured values are converted in a current or voltage signal. The device guarantees high accuracy and performances stability both versus time and temperature. The double channel allows the high density mounting where is necessary to reduce the encumbrances.

The programming is made by the dip-switch located in the window on the side of the enclosure. By means of dip-switches it is possible to select the input type and range and the output type without recalibrate the device. Moreover, by Personal Computer the user can program all of the device's parameters for his own necessity; the configuration by PC allows to program

the two channels with two independent settings. Moreover it is available the option of alarm for signal interruption (burn-out) that allows to set the output value as high or low out of scale .

The 1500 Vac galvanic isolation on all ways (inputs, outputs and power supply) eliminates the effects of all ground loops eventually existing and allows the use of the converter in heavy environmental conditions found in industrial applications.

The DAT 4532 C is in compliance with the Directive UL 61010-1 for US market and with the Directive CSA C22.2 No 61010-1 for the Canadian market. It is housed in a plastic enclosure of 12.5 mm thickness suitable for DIN rail mounting in compliance with EN-50022 and EN-50035 standards. USER INSTRUCTIONS

The connections must be made as shown in the section "Connections".


It is possible to configure the converter on field by dip-switch or Personal Computer as shown in the section "Programming ". The configuration by dip-switches can be made also if the device is powered (note: after the configuration the device takes some seconds to provide the right output measure). TECHNICAL SPECIFICATIONS (Typical at 25 °C and in nominal conditions)

INPUT (2 CHANNELS)				OUTPUT (2 CHANNELS)			5)	GENERAL SPECIFICATIONS	
Input type	Min	Мах	Span min	Output type	Min	Мах	Span min	Power supply voltage Reverse polarity prot	
PTC(*) KTY81-210 KTY81-220 KTY84-130	-55°C -55°C -40°C	150°C 150°C 300°C	50°C 50°C 50°C	Current Voltage	0 mA 0 V	20 mA 10 V	4 mA 1 V	Current consumption Current output Voltage output	
KTY84-150 NTC(*)	-40°C -40°C	300°C	50°C	Output resolutio Current Voltage	n	± 7 uA ± 4 mV		ISOLATION Among all the ways	1500 Vac, 50 Hz, 1 min
Coster 10K Coster 1K	-10°C -30°C	100°C 40°C	50°C 25°C	Burn-out values Max. output value Min. output value)	22 mA o 0 mA or		ENVIRONMENTAL (Operative Temperatu UL Operative Tempe	re -20°C +60°C
Pot. (Rnom.< 50KΩ)0 %100 %10 %Accuracy (1)PTC, NTCthe higher of ±0.1% and ±0.2°CPotentiometer± 0.05 % f.s.Linearity (1)PTC,NTC± 0.1 % f.s.Sensor excitation currentPTC,NTC500 uALine resistance influence (1)RTD 3 wires0.05%/Ω (50 Ω max balanced)Thermal drift (1)			Output load Resistance - RloadCurrent output< 500 Ω		Storage Temperature Humidity (not conden Maximum Altitude Installation Category of installatio Pollution Degree MECHANICAL SPEC Material IP Code Wiring Tightening Torque Mounting	ased) 0 90 % 2000 m Indoor on II 2 CIFICATIONS Self-extinguish plastic IP20 wires with diameter 0.8÷2.1 mm² /AWG 14-18 0.8 N m in compliance with DIN			
Full scale ± 0.01% / °C (*) if the NTC or PTC sensor used does not match to the types indicated, verify that the characteristic ohm / °C of such sensor corresponds to the characteristic ohm / °C of the sensors listed above. If it does not, the device won't be							Weight CERTIFICATIONS EMC (for the Industr Immunity Emission UKCA (ref S.I. 2016 N Immunity Emission UL US Standard Canadian Standard CCN	EN 61000-6-2 EN 61000-6-4 I°1091) BS EN 61000-6-2 BS EN 61000-6-4 UL 61010-1 CSA C22.2 No 61010-1 NRAQ/NRAQ7	
suitable to measure the specific sensor. (1)referred to the input Span (difference between max. and min.)							Typology Classification File Number	Open Type device Industrial Control Equipment E352854	





CONFIGURATION BY DIP-SWITCHES

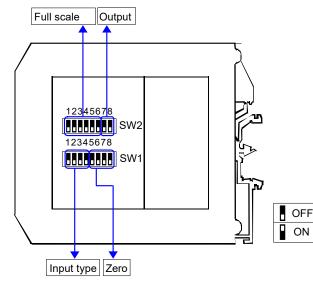


PROGRAMMING

- 1) Open the suitable door on the side of the device.
- 2) Set the input type by the dip-switch SW1 [1..4] (see TAB.1)

3) Set the minimum input scale value (Zero) by the dip-switch SW1 [5..8] (see TAB.3)

4) Set the maximum input value (Full scale) by the dip-switch SW2 [1..6] (see TAB.3)


5) Set the output type by the dip-switch SW2 [7..8] (see TAB.2)

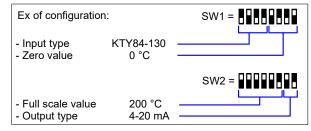

NOTE:

- It is also possible to set the dip-switches using the wizard of the configuration software following the procedure described in the section "Configuration by PC" until the step 6 and clicking on "Switch".

DIP-SWITCH CONFIGURATION TABLES



NOTES:

- * To configure the range for the input type selected (TAB.1) refer to the section of the TAB.3 on next page relative to it (ex: for Potentiometer use the table TAB.3b).
- * If the dip-switches SW1 [1..4] are all set in the position 0 ("EPROM"), the device will follow the configuration programmed by PC (input type and range, output type and range and options).
- * If the dip-switches SW1 [5..8] are all set in the position 0 ("Default"), the device will follow the input scale programmed by PC for the input type selected by the dip-switches SW1 [1..4]
- * Eventual wrong dip-switches settings will be signalled by the blinking of the led "PWR".


CONFIGURATION BY PC

Notice: before to execute the next operations. check that the drivers of the cable CVPROG in use have been previously installed in the Personal Computer.

- By software DATAPRO it is possible to:
- set the default programming of the device;
- program the options not available with the dip-switch;
 (burn-out level, CJC offset, trip alarm settings, delay on output, etc...);
 read, in real time, the input and output measures;
- follow the dip-switches configuration wizard.

To configure the device follow the next steps:

- Open the protection plastic label on the front of the device.
- Connect the two plugs of cable CVPROG to the Personal Computer
- (USB plug) and to the device (uUSB plug).
- 3) Run the software
- 4) Select the COM port in use and click on "Open COM".
- 5) Select the device and connect to it.
- 6) Set the programming data.
- 7) Click "Write" to send the programming data to the device.
- For information about the software refer to its user guide.

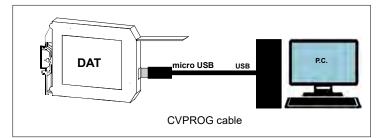

TAB.3a – Settings for PTC, NTC

Zero		Full scale			
SW1 5678	°C	SW2 1 2 3 4 5 6 °C	SW2 123456 °C	SW2 123456 °C	SW2 123456 °C
	Default	Defaul		210	370
	-200		80	220	380
	-150	5	85	230	390
	-100	10	90	240	400
	-50	15	95	250	425
	-40	20		260	450
	-30	25	110	270	475
	-20	30	120	280	500
	-10	35	130	290	525
	0	40	140	300	550
	5	45	150	310	600
	10	50	160	320	650
	20	55	170	330	700
	30	60	180	340	750
	50	65	190	350	800
	100	70	200	360	850

TAB.3b –Settings for Potentiometer

Zero		Full scale					
SW1	%	SW2	SW2	SW2	SW2		
5678	Default	123456 % Defau		1 2 3 4 5 6 % 66	1 2 3 4 5 6 % 98		
	0	5	36	68	100		
	15	6	38	70	100		
	20	8	40	72			
	25	10	42	74	100		
	30	12		76			
	35	14	46	78	100		
	40	16	48	80			
	45	18	50	82	100		
	50	20	52	84			
	55	22	54	86			
	60	24	56	88	100		
	65	26	58	90	100		
	70	28	60	92			
	75	30	62	94			
	80	32	64	96	100		

INSTALLATION INSTRUCTIONS

The device is suitable for fitting to DIN rails in the vertical position. For optimum operation and long life follow these instructions:


When the devices are installed side by side it may be necessary to separate them by at least 5 mm in the following cases:

- If panel temperature exceeds 45°C.
- Use of high power supply value (> 27 Vdc).
- Use of output current.


Make sure that sufficient air flow is provided for the device avoiding to place raceways or other objects which could obstruct the ventilation slits. Moreover it is suggested to avoid that devices are mounted above appliances generating heat; their ideal place should be in the lower part of the panel.

Install the device in a place without vibrations.


Moreover it is suggested to avoid routing conductors near power signal cables (motors, induction ovens, inverters etc...) and to use shielded cable for connecting signals.

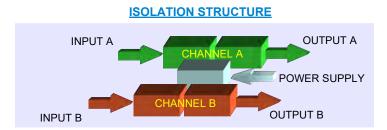

CONNECTIONS

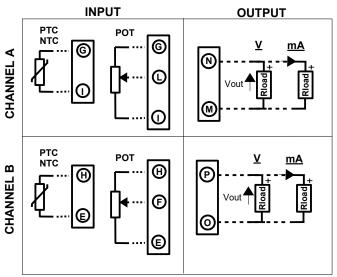

POWER SUPPLY(*)



(*) Note: for UL installation the device must be powered using a power supply unit classified NEC class 2 or SELV

LIGHT SIGNALLING

LED	COLOUR	STATE	DESCRIPTION
PWR	GREEN	ON	Device powered
		OFF	Device not powered
		BLINKING	Wrong dip-switches setting

DIMENSIONS (mm)

